



Aalborg Universitet

**AALBORG UNIVERSITY**  
DENMARK

## Measurement of Indoor Air Quality by Means of a Breathing Thermal Manikin

Brohus, Henrik

*Publication date:*  
2000

*Document Version*  
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

*Citation for published version (APA):*  
Brohus, H. (2000). *Measurement of Indoor Air Quality by Means of a Breathing Thermal Manikin*. Dept. of Building Technology and Structural Engineering, Aalborg University. Indoor Environmental Engineering Vol. R0051 No. 125

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

### Take down policy

If you believe that this document breaches copyright please contact us at [vbn@aub.aau.dk](mailto:vbn@aub.aau.dk) providing details, and we will remove access to the work immediately and investigate your claim.

# Measurement

Measurement of Indoor  
Air Quality by Means of  
a Breathing Thermal  
Manikin

*H. Brohus*



Paper No 125

Indoor Environmental Engineering

Proceedings of the Third International Meeting on  
Thermal Manikin Testing, 3IMM. National Institute for  
Working Life, Stockholm, 2000 (Eds. H. O. Nilsson, I.  
Holmér). Arbete och Hälsa, 2000:4. ISBN 91-7045-554-6,  
p. 83-87



The ***Indoor Environmental Engineering*** papers are issued for early dissemination of research results from the Indoor Environmental Engineering Group at the Department of Building Technology and Structural Engineering, Aalborg University. These papers are generally submitted to scientific meetings, conferences or journals and should therefore not be widely distributed. Whenever possible, reference should be given to the final publications (proceedings, journals, etc.) and not to the Indoor Environmental Engineering papers.

# Measurement of Indoor Air Quality by Means of a Breathing Thermal Manikin

*H. Brohus*



# Measurement of Indoor Air Quality by means of a Breathing Thermal Manikin

Henrik Brohus

Aalborg University, Sohngaardsholmsvej 57, DK-9000 Aalborg, Denmark

E-mail: hb@civil.auc.dk Fax: +45 9814 8243 Phone: +45 9635 8539

## INTRODUCTION

In order to assess the indoor air quality of a ventilated room it is necessary to know at least the pollution load and the air change rate. By means of a simple mass balance it is possible to determine the contaminant concentration of the return air. If the room air is completely mixed and possible concentration gradients are neglected the contaminant concentration throughout the room equals the return concentration. However, the assumption of complete mixing may cause erroneous assessment of the personal exposure if significant concentration gradients prevail for instance close to the pollution sources or in case of displacement ventilation (Brohus and Nielsen, 1996). Errors exceeding one order of magnitude are reported (Brohus, 1997).

When a person is located in a contaminant field with significant gradients the contaminant distribution is modified locally due to the entrainment and transport of room air in the human convective boundary layer as well as due to the effect of the person acting as an obstacle to the flow field, etc. The local modification of the concentration distribution may affect the personal exposure significantly and, thus, the indoor air quality actually experienced. In this paper measurements of indoor air quality by means of a Breathing Thermal Manikin (BTM) are presented.

## BREATHING THERMAL MANIKIN

The BTM is shaped as a 1.7 m high average sized woman, developed from an anatomically correct female display manikin consisting of a fibreglass-armed polyester shell, See Figure 1. The shell is wound with nickel wire used sequentially both for the heating of the manikin and for measuring and controlling the skin temperature. The BTM is controlled to obtain a skin temperature and a heat output corresponding to people in thermal comfort (Tanabe et al., 1994). The BTM is wearing tight-fitting clothes with an insulation value of 0.8 clo. Respiration is simulated by means of an artificial lung.

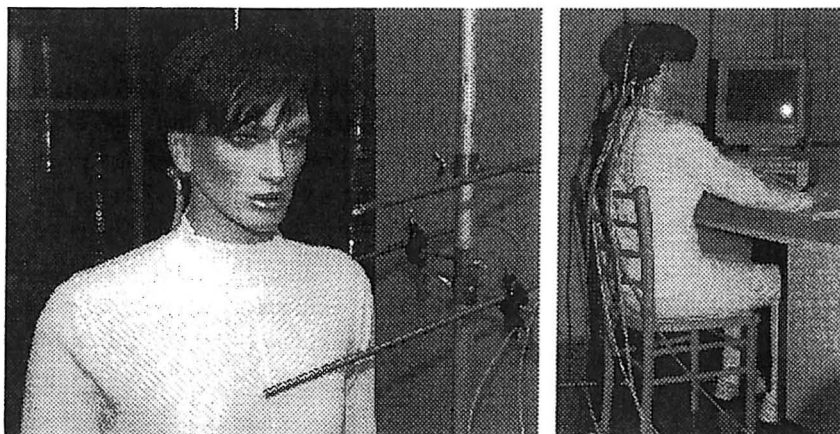



Figure 1. Breathing Thermal Manikin (BTM) used to measure the indoor air quality.



## EXPERIMENTAL SET-UP

Two different set-ups are examined in order to demonstrate the use of the BTM. CASE 1: Exposure to a point contaminant source in a uniform velocity field examined by means of the BTM located in a wind channel, see Figure 2. CASE 2: Personal exposure to emission from a "modelled carpet" located in a mock-up of a typical cell office, see Figure 3.

In both cases the contaminant source comprises nitrous oxide mixed with helium in order to obtain a density neutral tracer gas. In CASE 1 the tracer gas is supplied through a porous foam rubber ball,  $\varnothing$  0,1 m. In CASE 2 the tracer gas is supplied through a perforated and branched plastic tube shaped as an H, located below a perforated plastic film covering the entire mock-up floor. The tracer gas concentration is measured by means of photoacoustic spectroscopy.

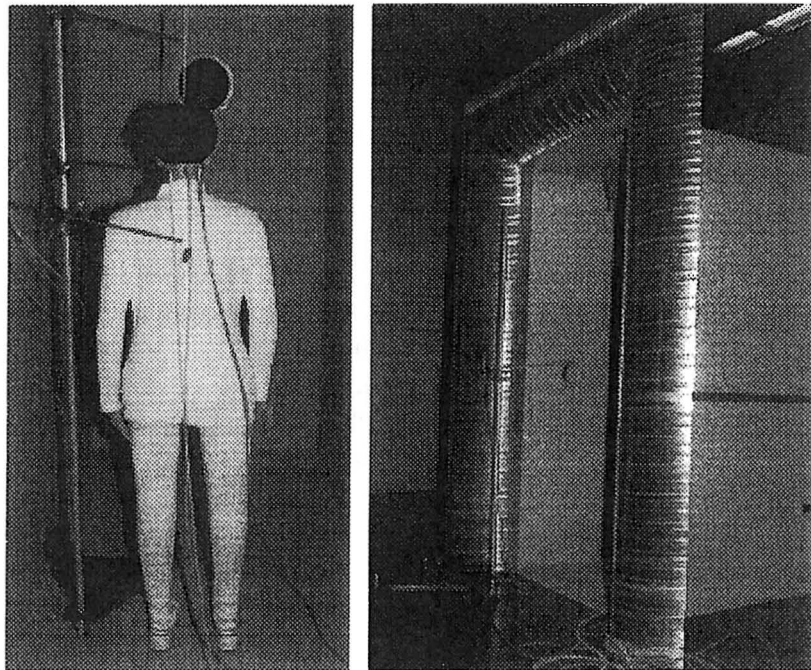


**Figure 2.** CASE 1. Personal exposure to a point contaminant source examined in the unidirectional flow field of a wind channel.


## RESULTS

The measurements performed in the wind channel on personal exposure to a passive point contaminant source in a uniform flow field are presented in Figure 4, showing the measured personal exposure for different vertical locations of the point contaminant source as a function of the velocity level when the source is located at a fixed horizontal distance of 0.5 m from the BTM. For more details see Brohus (1997).

Table 1 shows the results of indoor air quality measured by means of the BTM located in the office mock-up in case of the entire floor acting as a planar contaminant source. Apart from the personal exposure,  $c_e^*$ , the contaminant concentration at a neutral location in breathing zone height,  $c_P^*$ , is measured. Results from two different ventilation strategies are mentioned. During the old strategy the heating and the supply of fresh air are both provided by the ventilation system. The new strategy separates the heating and the supply of fresh air (isothermal ventilation and heating panels). For more details see Brohus and Hyldgaard, 1998 and Pejtersen et al., 1999.

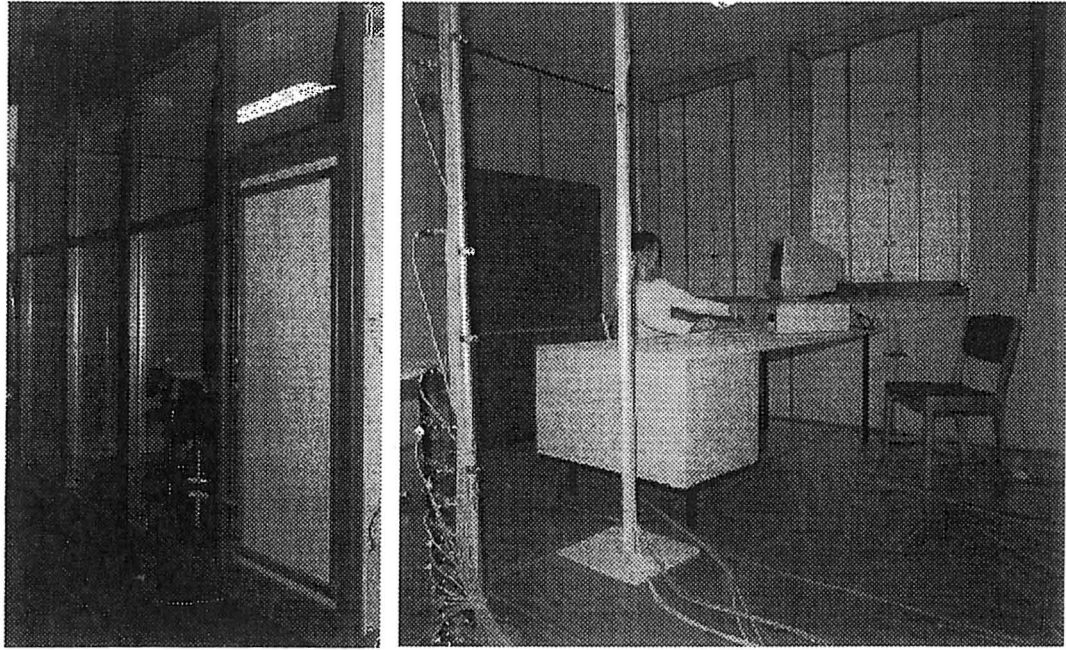

**Figure 3.** CASE 2. Personal exposure to emission from a carpet in a typical cell office. *Left:* Mock-up seen from outside. *Right:* Mock-up seen from inside.

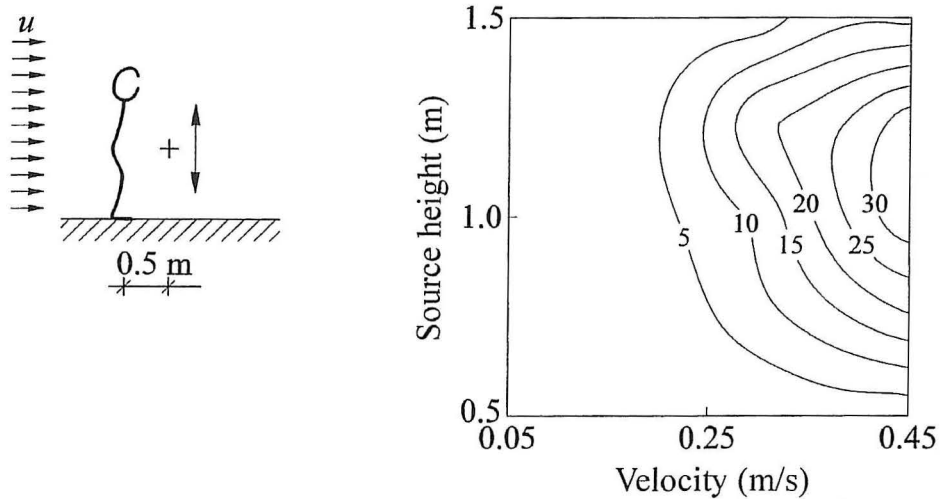

**Figure 4.** Results from CASE 1. Personal exposure,  $c_e^*$ , of the BTM standing in a uniform velocity field as a function of velocity level and vertical point source location above the floor. The results are made dimensionless by dividing by the contaminant concentration measured in the return opening of the wind channel.

**Table 1.** Results from CASE 2.  $c_e^*$  is measured by means of the BTM.  $c_p^*$  is measured in the centre of the office at a height of 1.1 m. The results are made dimensionless by dividing by the contaminant concentration measured in the return air.

Ventilation strategy	$c_e^*$	$c_p^*$
Old	2.37	1.17
New	1.18	1.06



## DISCUSSION

Figure 4 shows the results on personal exposure to a passive point contaminant source in a uniform flow field (CASE 1). The uniform flow field may also represent the local flow field around a person located in a mixing ventilated room. The contaminant source might represent for instance an ashtray. The case shows that the exposure depends strongly on both source location and velocity level. Dimensionless exposure levels exceeding 30 are found, i.e. the actual concentration of inhaled contaminant is 30 times higher than the concentration obtained if the assumption of complete mixing was applied. A distinct influence of the location relative to the wind direction and the contaminant source is reported by Brohus (1997).

The results from Table 1 (CASE 2) clearly show the importance of proper measuring equipment, here, in shape of the BTM.  $c_e^*$  and  $c_p^*$  are measured at the same height and the difference is due almost solely to the local influence of the person. In case of the old ventilation strategy, the personal exposure is twice as high as the return concentration and also twice as high as the corresponding concentration measured at a neutral location at breathing zone height. Obviously, the convection current along the thermal manikin entrains and transports contaminant from the floor area to the breathing zone.

The results of the full-scale exposure measurements by means of the Breathing Thermal Manikin show the importance of a proper tool for the assessment of indoor air quality in ventilated rooms where concentration gradients prevail. The human convective boundary layer is found to affect the local concentration distribution considerably together with the effect of the person acting as an obstacle to the general flow field.

## REFERENCES

- Brohus, H. (1997) Personal Exposure to Contaminant Sources in Ventilated Rooms, Ph.D.-thesis, ISSN 0902-7953 R9741, Department of Building Technology and Structural Engineering, Aalborg University, Denmark.  
*Free download in pdf-format from [http://iee.civil.auc.dk/i6/klima/publ-all.html#phd\\_diss](http://iee.civil.auc.dk/i6/klima/publ-all.html#phd_diss)*
- Brohus, H. and Nielsen, P.V. (1996) Personal Exposure in Displacement Ventilated Rooms, *Indoor Air*, Vol. 6, No. 3, pp. 157 - 167.
- Brohus, H., Hyldgaard, C.E. (1998) The use of Tracer Gas Measurements in Detection and Solution of Indoor Air Quality Problems in a Danish Town Hall, *In: Moschandreas, D.J. (Ed.): Design, Construction, and Operation of Healthy Buildings: Solutions to Global and Regional Concerns*, ISBN 1-883413-66-4, pp. 57-66, ASHRAE, Atlanta, GA, USA.
- Pejtersen, J., Brohus, H., Hyldgaard, C.E., Nielsen, J.B., Valbjørn, O., Hauschildt, P., Kjærgaard, S.K., Wolkoff, P. (1999) The Effect of Renovating an Office Building on Occupants' Comfort and Health, *Proceedings of Indoor Air 99, The 8th International Conference on Indoor Air Quality and Climate*, Vol. 2, pp. 160-165, Edinburgh, Scotland.
- Tanabe, S., Arens, E.A., Bauman, F.S., Zhang, H., Madsen, T.L. (1994) Evaluating Thermal Environments by Using a Thermal Manikin with Controlled Skin Surface Temperature, *ASHRAE Transactions*, Vol. 100, Part 1, pp.39-48.

## ACKNOWLEDGEMENT

This work has been supported financially by The Danish Technical Research Council (STVF) as part of the research programme of the International Centre for Indoor Environment and Energy.





## RECENT PAPERS ON INDOOR ENVIRONMENTAL ENGINEERING

PAPER NO. 110: P. Heiselberg: *Hybrid Ventilation and the Consequences on the Development of the Facade*. ISSN 1395-7953 R0033.

PAPER NO. 111: P. Heiselberg, M. Pedersen, T. Plath: *Local Exhaust Optimization and Worker Exposure*. ISSN 1395-7953 R0034.

PAPER NO. 112: K. Svidt, P. Heiselberg: *Push-Pull Ventilation in a Painting Shop for Large Steel Constructions*. ISSN 1395-7953 R0035.

PAPER NO. 113: P. Heiselberg: *Design Principles for Natural and Hybrid Ventilation*. ISSN 1395-7953 R0036

PAPER NO. 114: A. Andersen, M. Bjerre, Z.D. Chen, P. Heiselberg, Y. Li: *Experimental Study of Wind-Opposed Buoyancy-Driven Natural Ventilation*. ISSN 1395-7953 R0037

PAPER NO. 115: P. Heiselberg, K. Svidt, P.V. Nielsen: *Windows - Measurements of Air Flow Capacity*. ISSN 1395-7953 R0040

PAPER NO. 116: K. Svidt, P. Heiselberg, P.V. Nielsen: *Characterization of the Airflow from a Bottom Hung Window under Natural Ventilation*. ISSN 1395-7953 R0041

PAPER NO. 117: Z. Yue, P.V. Nielsen: *Flow Pattern in Ventilated Rooms with Large Depth and Width*. ISSN 1395-7953 R0042.

PAPER NO. 118: P.V. Nielsen, H. Dam, L.C. Sørensen, K. Svidt, P. Heiselberg: *Characteristics of Buoyant Flow from Open windows in Naturally Ventilated Rooms*. ISSN 1395-7953 R0043.

PAPER NO. 119: P.V. Nielsen, C. Filholm, C. Topp, L. Davidson: *Model Experiments with Low Reynolds Number Effects in a Ventilated Room*. ISSN 1395-7953 R0044.

PAPER NO. 120: P. Lengweiler, P.V. Nielsen, A. Moser, P. Heiselberg, H. Takai: *Experimental Method for Measuring Dust Load on Surfaces in Rooms*. ISSN 1395-7953 R0045.

PAPER NO. 121: L. Davidson, P.V. Nielsen, C. Topp: *Low-Reynolds Number Effects in Ventilated Rooms: A Numerical Study*. 1395-7953 R0046.

PAPER NO. 122: F. Haghighat, H. Brohus, C. Frier, P. Heiselberg: *Stochastic Prediction of Ventilation System Performance*. ISSN 1395-7953 R0047.

PAPER NO. 123: H. Brohus, F. Haghighat, C. Frier, P. Heiselberg: *Quantification of Uncertainty in Thermal Building Simulation. Part 1: Stochastic Building Model*. ISSN 1395-7953 R0048.

PAPER NO. 124: H. Brohus, F. Haghighat, C. Frier, P. Heiselberg: *Quantification of Uncertainty in Thermal Building Simulation. Part 2: Stochastic Loads*. ISSN 1395-7953 R0049.

PAPER NO. 125: H. Brohus: *Measurement of Indoor Air Quality by Means of a Breathing Thermal Manikin*. ISSN 1395-7953 R0051.

**Complete list of papers: <http://www.civil.auc.dk/i6/publ/IEE-list.html>**



# Messuren

ISSN 1395-7953 R0051

Dept. of Building Technology and Structural Engineering

Aalborg University, December 2000

Sohngaardsholmsvej 57, DK-9000 Aalborg, Denmark

Phone: +45 9635 8080 Fax: +45 9814 8243